

GENERAL NOTES

1. INSTALL NEW FLUID APPLIED MEMBRANE TO MAIN ROOF, LOADING DOCK ROOF, AND CANOPY ROOFS.
2. CONDUCT THERMO SCAN OF ROOF PRIOR TO INSTALLATION TO IDENTIFY ANY WET AREAS. PROVIDE FOR REPLACEMENT OF 300 SQ FT OF MATERIAL IN BASE BID.
3. REMOVE AND DISPOSE OF ALL THE ROOFING MATERIAL IN ACCORDANCE WITH ALL APPLICABLE LAWS AND REGULATIONS.
4. REFER TO EXISTING RECORD DRAWINGS FOR ROOF FRAMING. THE ROOF STRUCTURE ITSELF SLOPES IN MULTIPLE DIRECTIONS FOR DRAINAGE.
5. SEE SHEET A-302 FOR ROOF DETAILS.
6. REFER TO MANUFACTURER'S WRITTEN INSTRUCTIONS FOR INSTALLATION.
7. INSTALLER MUST BE CERTIFIED BY MANUFACTURER.

EF = EXHAUST FAN
SF = SUPPLY FAN
DS = DOWN SPOUT
PV = PIPE VENT
EL = ELECTRICAL CONDUIT
HPV = HOT PIPE VENT

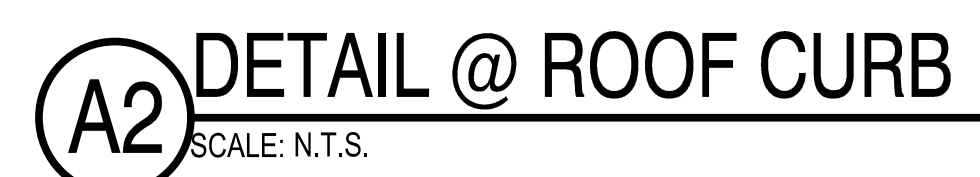
APPROVED		DATE		APPR	
FOR COMMANDER NAVFAC		ACTIVITY		100% SUBMISSION	
SATISFACTORY TO		DATE		06/16/23	
DES		CJW		CHK	
PM/DM		CJW		ACO	
BRANCH MANAGER		CRB		KA	
CHIEF ENG/ARCH		I		I	
FIRE PROTECTION		I		I	
DEPARTMENT OF THE NAVY		NAVAL FACILITIES ENGINEERING SYSTEMS COMMAND		NAVAL SUBMARINE BASE NEW LONDON	
NAVAL FACILITIES ENGINEERING SYSTEMS COMMAND		MID-ATLANTIC		GROTON, CT	
NAVAL STATION - NORFOLK, VIRGINIA		B446 ROOF REPAIRS		ROOF PLAN	
SCALE:		AS NOTED		PROJECT NO. 1760571	
CONSTR. CONTR. NO.		#####		NAVFAC DRAWING NO. ##	
SHEET		2 OF 4		A-103	
DRAWING REVISION: 25 AUGUST 2020					



C



A

D