






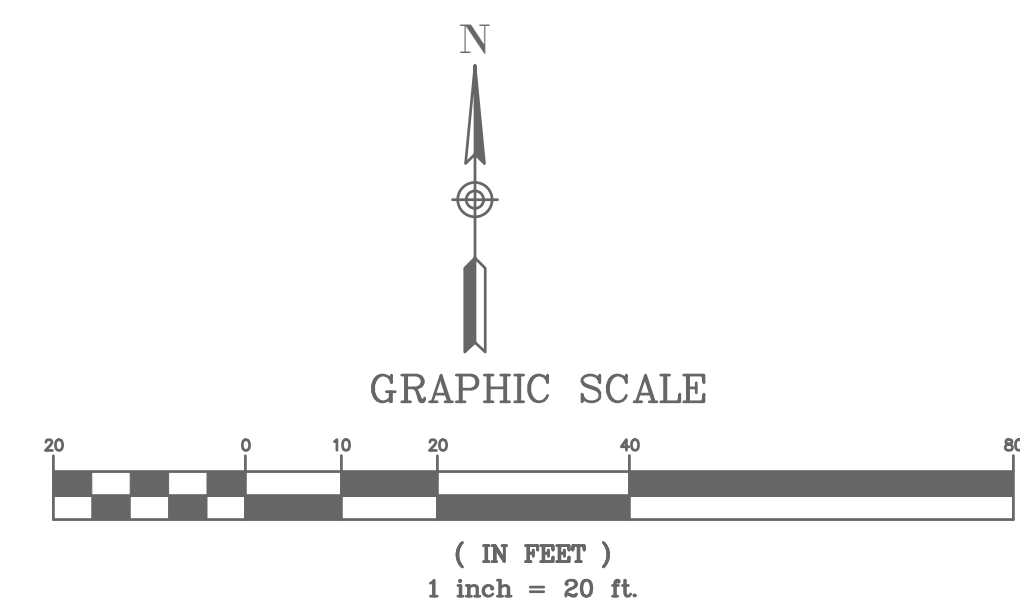

GENERAL NOTES:

[illegible]

DESIGNED BY:	ISSUE DATE:
R. R. LEON	FEBRUARY 2022
DRAWN BY:	SOLICITATION NO.:
R. R. LEON	W91328-XX-X-XXXX
CHECKED BY:	CONTRACT NO.:
D. D. CARULLI	W91328-XX-X-XXXX
SUBMITTED BY:	SPEC NO.:
A. PASQUA, PE	2410
SIZE:	DESIGN FILE NO.:
ANSI D	130-25-0933

ARMY CORPS OF ENGINEERS  
SACRAMENTO DISTRICT  
1325 J STREET  
SACRAMENTO, CA 95814

IN-HOUSE DESIGN  
1325 J STREET  
SACRAMENTO, CA 95814


DDJC TRACY, CA  
12KV OVERHEAD TO UNDERGROUND POWER LINE REPLACEMENT  
PN# 490571

SITE PLAN DEMO  
STATION 10+00 TO 12+00  
BASE BID

SHEET ID



ED101



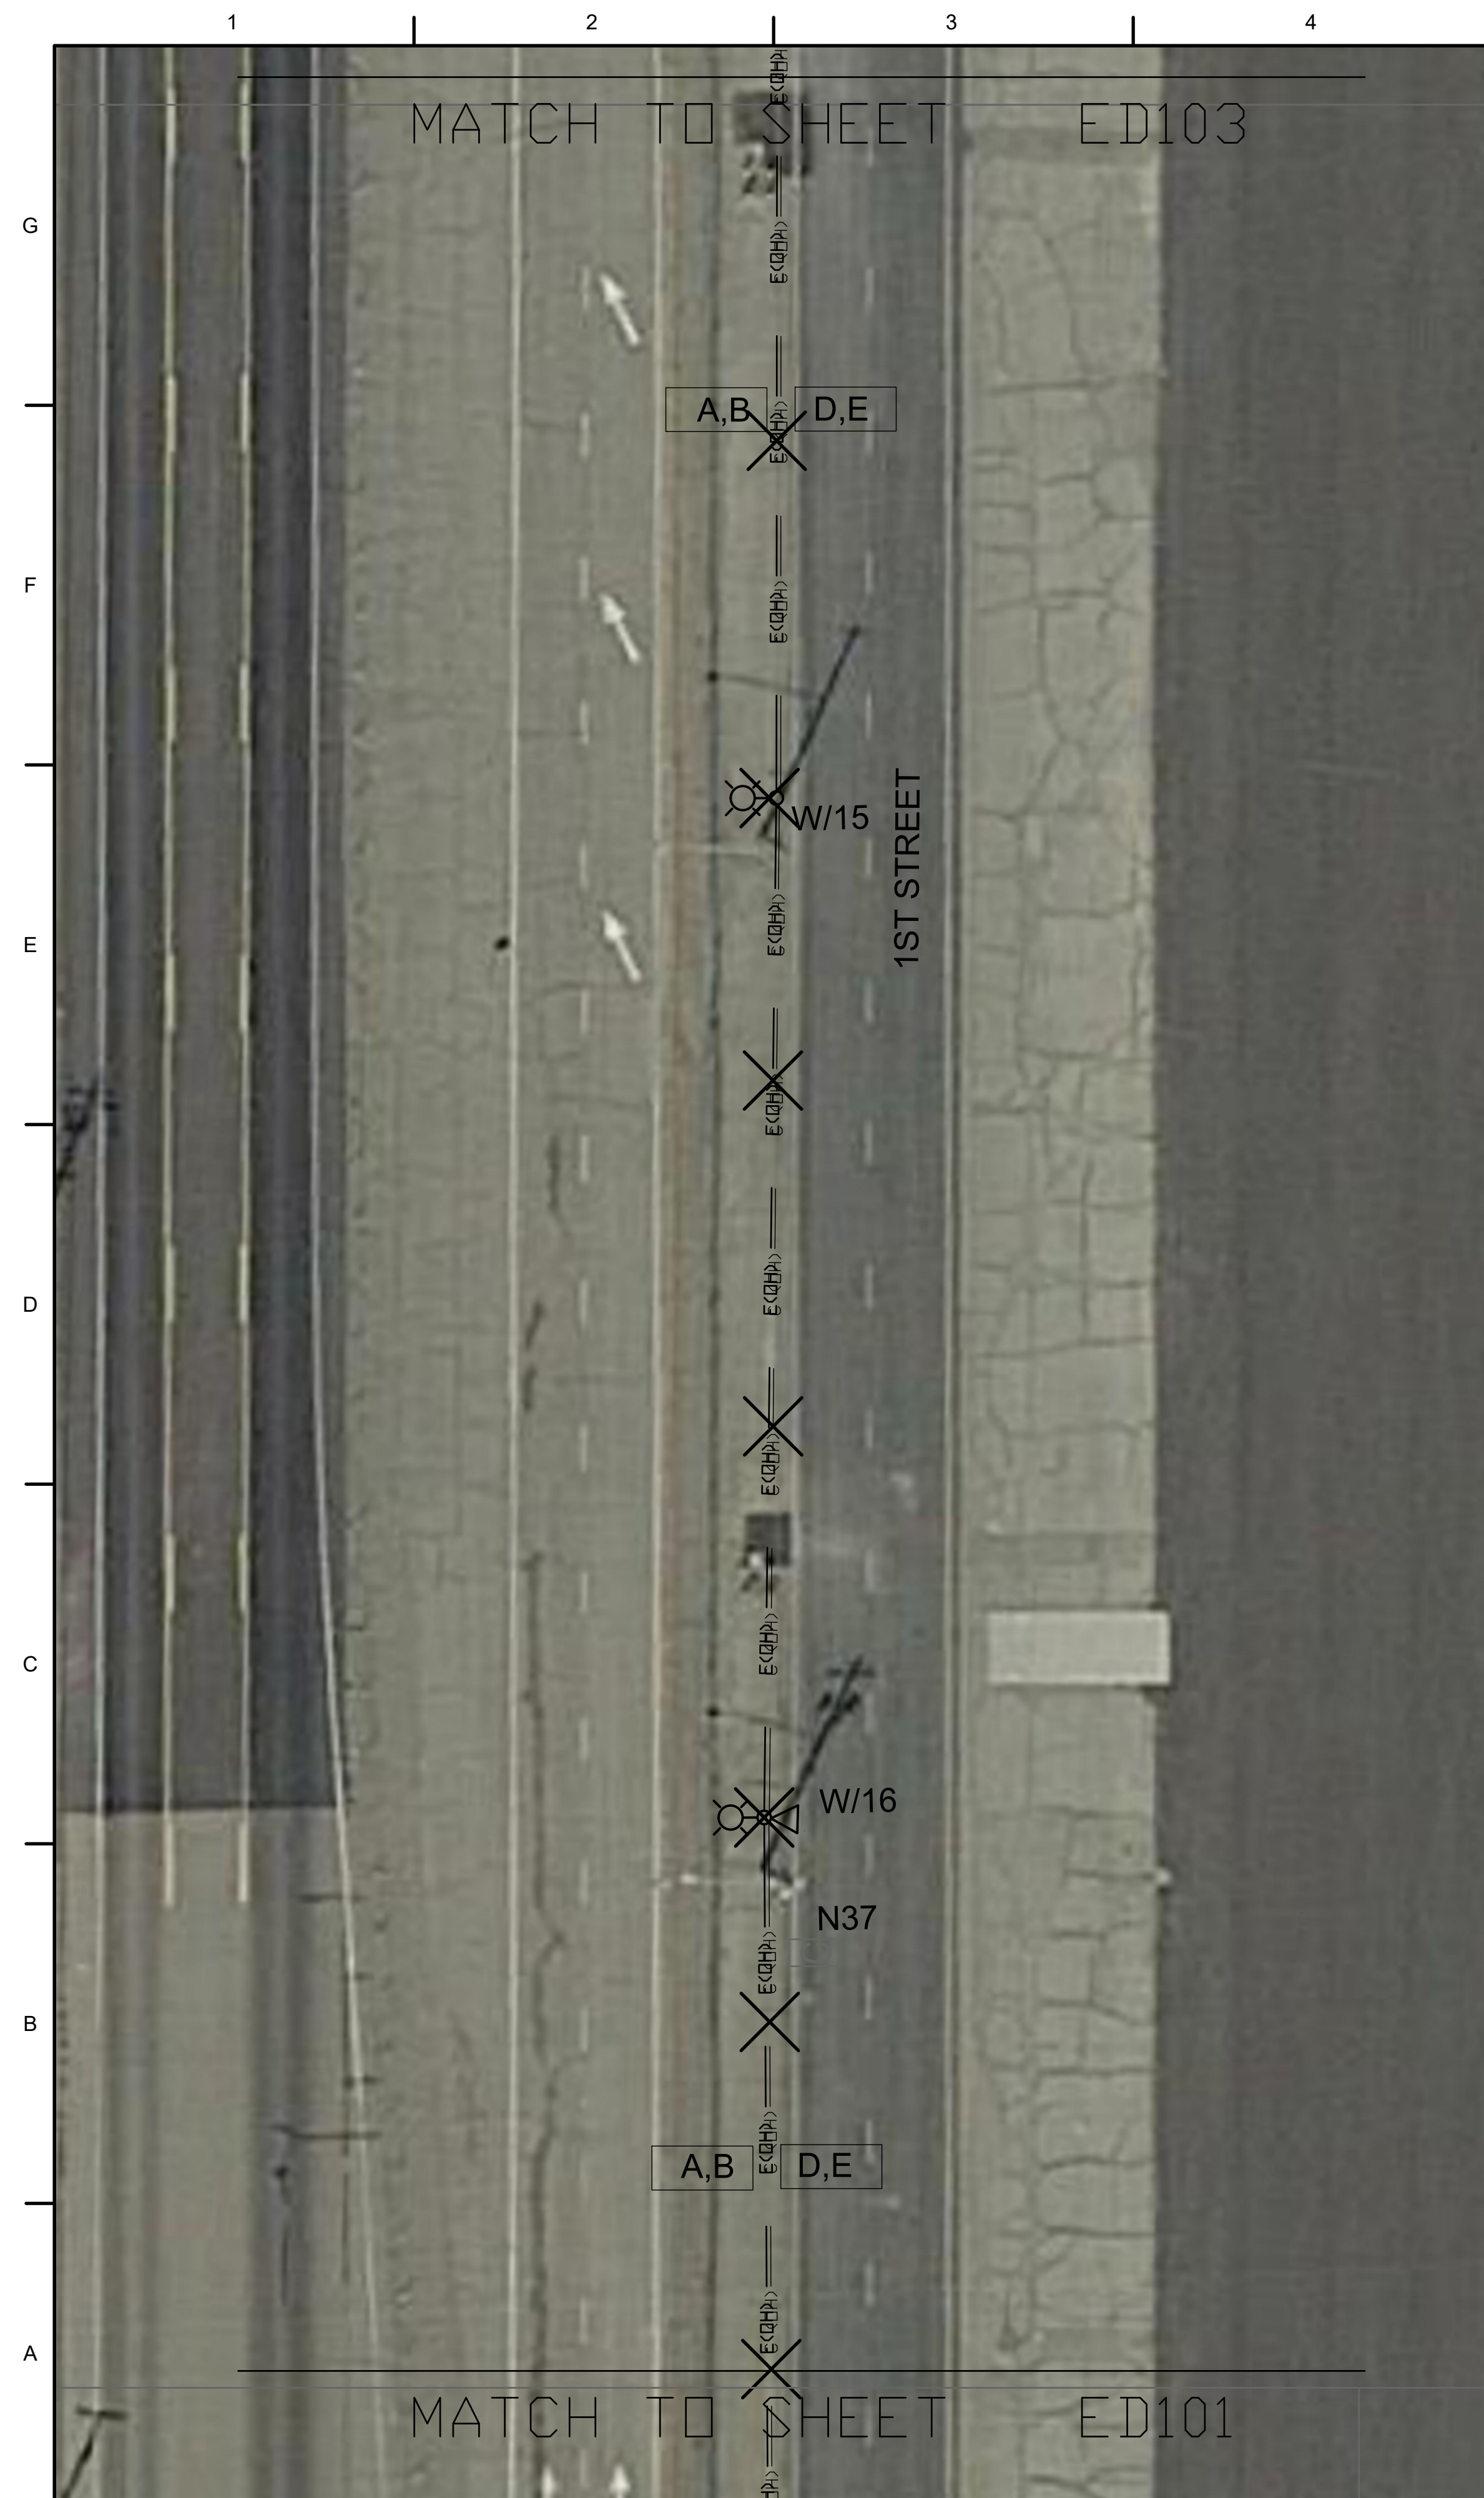

GENERAL NOTES:

1. FIELD VERIFY EXISTING CONDITIONS.
2. DEMOLISH ALL OVERHEAD LINES AND POLES STARTING FROM POLE W/18A AND ENDING AT POLE A/3.
3. DEMOLISH ALL EQUIPMENT ON POLES.
4. REFER TO SHEET E-001 FOR LEGEND AND ABBREVIATIONS.
5. CHECK PHASE ROTATION BEFORE AND AFTER SWITCHING OH 12KV TO UNDERGROUND CABLE.

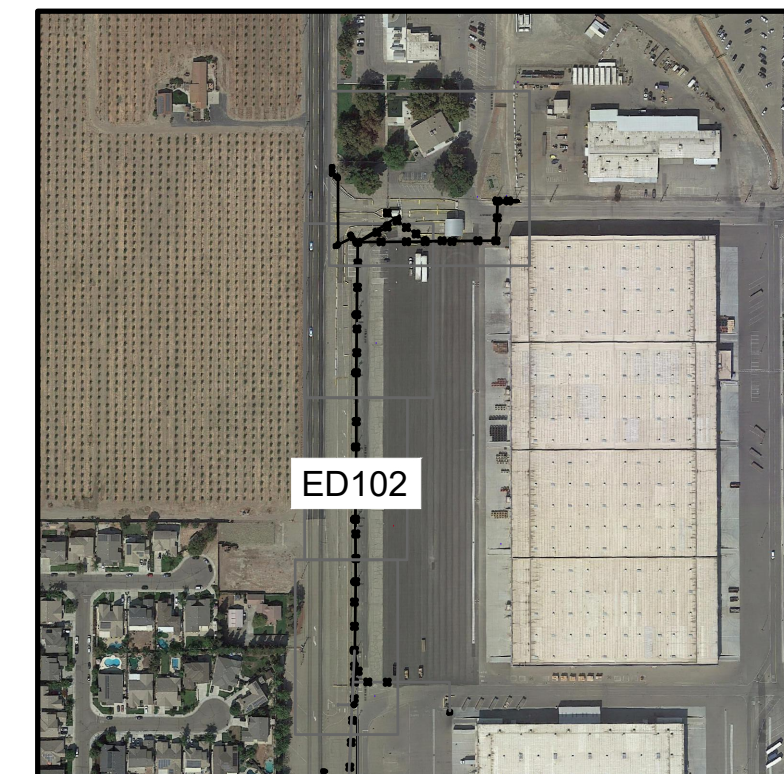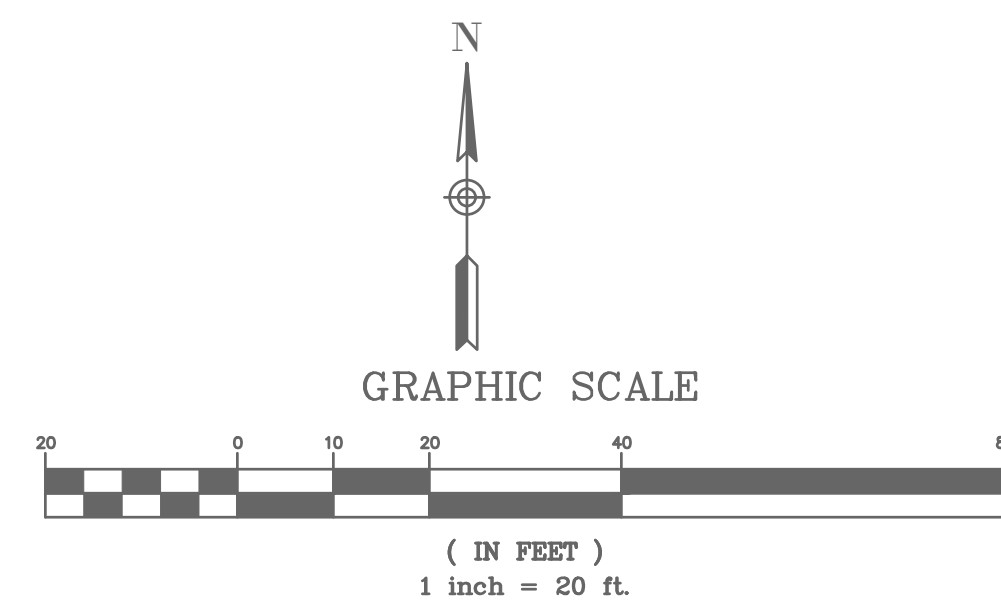

US Army Corps  
of Engineers®

[illegible]

ISSUE DATE:	FEBRUARY 2022
DRAWN BY:	SOLICITATION NO.: W91328-XX-X-XXXX
CHECKED BY:	CONTRACT NO.: W91328-XX-X-XXXX
SUBMITTED BY:	SPEC NO.: 2410
SIZE:	DESIGN FILE NO:
ANSI D	130-25-0933

ARMY CORPS OF ENGINEERS  
SACRAMENTO DISTRICT  
1325 J STREET  
SACRAMENTO, CA 95814

---

IN-HOUSE DESIGN  
1325 J STREET  
SACRAMENTO, CA 95814

DDJC TRACY, CA  
12KV OVERHEAD TO UNDERGROUND POWER LINE REPLACEMENT  
PN# 490571

DDJC TRACY, CA  
TO UNDERGROUND POWER LINE  
PN# 490571

SITE PLAN DEMO  
STATION 12+00 TO 16+00  
BASE BID

SHEET ID

ED102







